

Test report: H13-60003-1

Page 1 of 12

LQF-708-02
Review No:06

EPIL/HV TEST REPORT

Project No.: H13-60003-1

Equipment under Test: MV Capacitor

| | |
|----------------------|---------------------|
| Type | : PK 200/19.05 EDRI |
| Serial Number | : T-T-19.05 |
| Rated Voltage | : 19.05 kV |
| Rated Power | : 200 kVAR |
| Rated Capacitance | : 1.76 μ F |
| Rated Frequency | : 50 Hz |
| Rated Current | : 10.5 A |
| Insulation Level | : 50/145 kV |
| Temperature Category | : -40/55°C |

Manufactured by: PARTO KHAZEN Co.

Applicant: PARTO KHAZEN Co.

Applicant Contact Information: +98-21-88882956



Trade Mark: PKC

Tested According to: IEC 60871-1:2014

Reception Date of Sample: 10-Mar-2021

Testing Date: 19 to 22-June-2021

Issue Date: 20-July-2021

Test Result: See pages 4 to 9

No. of Pages: 12

Prepared and Tested by: Test Engineer

A. Fakzare

Chief Executive Officer

S. M. Mirsadri

Verified by: Technical Manager

H. Jahangir

Engineering Deputy of
Test and Inspection

Prof. B. Vahidi / Prof. S. H. Fathi

The statement of conformity decision is made based on EPIL Procedure No., CBP-708-01 and ISO/IEC Guide 98-4.

EPIL
Technical Department
ISO IEC 17025
Accredited Lab

This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.

CONTENTS

| | Page |
|---|------|
| 1 GENERAL INFORMATION | 3 |
| 1.1 Product Information..... | 3 |
| 1.2 Client Information..... | 3 |
| 1.3 Performed Tests..... | 3 |
| 1.4 Test Results and Descriptions | 3 |
| 2 PERFORMANCE and RESULTS of TESTS | 4 |
| 2.1 Capacitance measurement (Routine Test)..... | 4 |
| 2.2 Measurement of the Tangent of the Loss Angle of the Capacitor (Routine Test)..... | 5 |
| 2.3 Thermal Stability Test (Type Test)..... | 6 |
| 2.4 Measurement of the Tangent of the Loss Angle of the Capacitor at Elevated Temperature (Type Test)..... | 9 |
| 3 FIGURES | 10 |
| ANNEX A: EUT ELEMENT CONFIGURATION | 12 |



This report should not be reproduced in extracts without written approval by EPIL.

Test results pertain to the tested sample only.

Not Valid Without Lab Stamp.

Test report: H13-60003-1

Page 3 of 12

1. GENERAL INFORMATION

1.1. Product Information

| | |
|----------------------|---------------------|
| Equipment under Test | : MV Capacitor |
| Manufacturer | : PARTO KHAZEN Co. |
| Type | : PK 200/19.05 EDRI |
| Serial Number | : T-T-19.05 |
| Rated Voltage | : 19.05 kV |
| Rated Power | : 200 kVAR |
| Rated Capacitance | : 1.76 μ F |
| Rated Frequency | : 50 Hz |
| Insulation Level | : 50/145 kV |
| Temperature Category | : -40/55°C |
| Normative Document | : IEC 60871-1:2014 |

1.2. Client Information

| | |
|-----------|--------------------|
| Applicant | : PARTO KHAZEN Co. |
| Telephone | : +98-21-88882956 |
| Fax | : +98-21-88882959 |


1.3. Performed Tests

| Test | Test According to | Result |
|---|-------------------|------------|
| Capacitance Measurement (Routine Test) | IEC 60871-1:2014 | Passed |
| Measurement of the Tangent of the Loss Angle of the Capacitor (Routine Test) | IEC 60871-1:2014 | Performed* |
| Thermal Stability Test (Type Test) | IEC 60871-1:2014 | Passed |
| Measurement of the Tangent of the Loss Angle of the Capacitor at Elevated Temperature (Type Test) | IEC 60871-1:2014 | Performed* |

* The requirements regarding capacitor losses shall be agreed upon between manufacturer and purchaser. Since no value was notified to the laboratory, the result of the test is given as "Performed".

1.4. Test Results and Descriptions:

See pages 4 to 9.

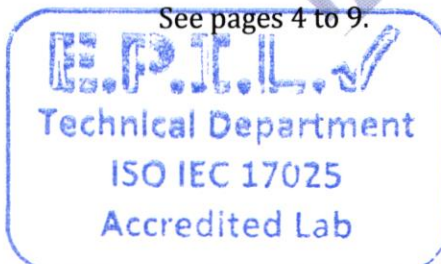

*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*

2. PERFORMANCE and RESULTS of TESTS

2.1 Capacitance Measurement (Routine Test)

2.1.1 Test data

| | |
|----------------------------|--------------------|
| Equipment Under Test (EUT) | : MV Capacitor |
| Manufacturer | : PARTO KHAZEN Co. |
| Location | : E.P.I.L |
| Date | : 19-June-2021 |
| Test Expert | : Ms. Takzare |
| Normative Document | : IEC 60871-1:2014 |

2.1.2 Ambient conditions

| | |
|---------------------|---------|
| Ambient Temperature | : 25 °C |
| Relative Humidity | : 45 % |

2.1.3 Performance of test

The capacitance is measured at rated voltage according to clause 7.1 of IEC 60871-1: 2014. In order to reveal any change in capacitance, a preliminary measurement is performed with a reduced voltage not higher than 0.15 U_N.

2.1.4 Acceptance conditions of test

The capacitance shall not differ from the rated capacitance by more than -5% to +10%.

2.1.5 Result of test

Table 1. Result of capacitance measurement

| Applied Voltage (kV) | Measured Capacitance (μF) | Result |
|----------------------|---------------------------|--------|
| 19.05 | 1.7362 | Passed |
| 2.80 | 1.7390 | |

2.2 Measurement of the Tangent of the Loss Angle of the Capacitor (Routine Test)

2.2.1 Test data

| | |
|----------------------------|--------------------|
| Equipment Under Test (EUT) | : MV Capacitor |
| Manufacturer | : PARTO KHAZEN Co. |
| Location | : E.P.I.L |
| Date | : 19-June-2021 |
| Test Expert | : Ms. Takzare |
| Normative Document | : IEC 60871-1:2014 |

2.2.2 Ambient conditions

| | |
|---------------------|---------|
| Ambient Temperature | : 25 °C |
| Relative Humidity | : 45 % |

2.2.3 Performance of test

The capacitor losses ($\tan\delta$) is measured at rated voltage according to clause 8.1 of IEC 60871-1:2014.

2.2.4 Acceptance condition of test

The requirements regarding capacitor losses shall be agreed upon between manufacturer and purchaser.

2.2.5 Result of Test

Table 2: Result of measurement of the tangent of the loss angle

| Applied Voltage (kV) | Measured $\tan\delta$ | Result |
|----------------------|-----------------------|------------|
| 19.05 | 1.19×10^{-4} | Performed* |

* The requirements regarding capacitor losses shall be agreed upon between manufacturer and purchaser. Since no value was notified to the laboratory, the result of the test is given as "Performed".

Test report: H13-60003-1

Page 6 of 12

2.3 Thermal Stability Test (Type Test)

2.3.1 Test data

| | |
|----------------------------|--------------------------------|
| Equipment under Test (EUT) | : MV Capacitor |
| Manufacturer | : PARTO KHAZEN Co. |
| Location | : E.P.I.L |
| Date | : 20-June-2021 to 22-June-2021 |
| Test Expert | : Ms. Takzare |
| Normative Document | : IEC 60871-1:2014 |

2.3.2 Ambient conditions

| | |
|---------------------|---------|
| Ambient Temperature | : 25 °C |
| Relative Humidity | : 45 % |

2.3.3 Performance of test

The capacitor unit subjected to the test is placed between two dummy capacitors each containing resistors. The dissipation in the resistors is adjusted to a value such that the case temperature of the dummy capacitors near the top opposing faces are equal to or greater than those of the test capacitor. The separation between the units is 10 cm, which according to manufacturer claim, is equal to or less than the normal spacing. The assembly is placed in a heated enclosure with no forced ventilation with ambient air temperature at or above the appropriate temperature shown in Table 2 of IEC 60871-1 (55 °C for symbol D capacitor). The test capacitor is subjected for a period of at least 48 h, to an a.c. voltage of substantially sinusoidal form. The magnitude of the voltage throughout the test is adjusted to 23.0 kV to give an output of 1.44 times the capacitor rated power.



*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*

Test report: H13-60003-1

Page 7 of 12

LQF-708-02
Review No:06

Figure 2 (refer to section 3: FIGURES of the test report) shows the sensors arrangement during the thermal stability test. The sensors are applied as follows:

| |
|--|
| T1: Test room temperature |
| T2: Main capacitor near top temperature # 1 |
| T3: Main capacitor top temperature |
| T4: Main capacitor near top temperature # 2 |
| T5: Dummy capacitor 1 near top temperature # 1 |
| T6: Dummy capacitor 1 near top temperature # 2 |
| T7: Dummy capacitor 2 near top temperature # 1 |

2.3.4 Acceptance conditions of test

During the last 6 h the temperature of the container near the top shall be measured at least four times. Throughout this period of 6 h, the temperature rise shall not increase by more than 1 K. Should a greater change be observed, the test shall be continued until the above requirement is satisfied for four consecutive measurements during a subsequent 6 h period. In case the thermal stability condition is not reached in 72 h, the test shall be stopped and the capacitor shall be declared to have failed in this test.

Before and after the test the capacitance shall be measured within the temperature range according to 5.2 of IEC 60871 and the two measurements shall be corrected to the same dielectric temperature. The difference between the two measurements shall be less than an amount corresponding to either breakdown of an element or operation of an internal fuse.

2.3.5 Result of Test

Table 3 shows the temperatures measured for the last 6 hours of the test with 1 hour interval. Table 4 shows the result of measurement of capacitance at 25 °C and 19.05 kV before and after the thermal stability test.



*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*

Test report: H13-60003-1

Page 8 of 12

LQF-708-02
Review No:06

Table 3. Temperatures measured for the last 6 hours of the test


| Sensor Time | T1 (°C) | T2 (°C) | T3 (°C) | T4 (°C) | T5 (°C) | T6 (°C) | T7 (°C) |
|----------------|---------|---------|---------|---------|---------|---------|---------|
| 02:00 | 55.1 | 61.8 | 67.4 | 61.5 | 62.4 | 62.7 | 63.1 |
| 03:00 | 55.3 | 61.5 | 67.3 | 61.4 | 62.3 | 62.9 | 63.2 |
| 04:00 | 55.3 | 61.6 | 67.5 | 61.4 | 62.3 | 62.8 | 63.2 |
| 05:00 | 55.5 | 61.5 | 67.5 | 61.3 | 62.4 | 62.9 | 63.6 |
| 06:00 | 55.3 | 61.3 | 67.0 | 61.2 | 62.5 | 62.9 | 63.5 |
| 07:00 | 55.2 | 61.4 | 67.3 | 61.3 | 62.6 | 62.7 | 63.3 |
| 08:00 | 55.6 | 61.2 | 67.1 | 61.2 | 62.4 | 62.8 | 63.3 |

Table 4. Capacitance measured before and after the test

| | Before | After |
|------------------|--------|--------|
| Capacitance (µF) | 1.7362 | 1.7322 |

Throughout the last 6 h of the test, temperature rise above 1 °C is not observed and thermal stability is reached within 48 h. The difference between two capacitance measurements before and after the test is less than an amount corresponding to breakdown of an element (With reference to ANNEX A).

✓ PASSED

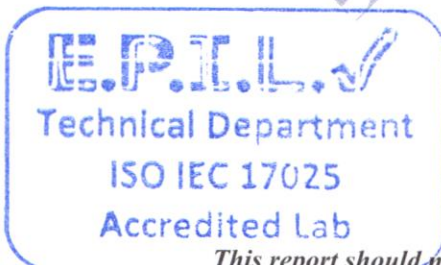

This report should not be reproduced in extracts without written approval by EPIL.

Test results pertain to the tested sample only.

Not Valid Without Lab Stamp.

2.4 Measurement of the Tangent of the Loss Angle of the Capacitor at Elevated Temperature (Type Test)

2.4.1 Test data

| | |
|----------------------------|--------------------|
| Equipment Under Test (EUT) | : MV Capacitor |
| Manufacturer | : PARTO KHAZEN Co. |
| Location | : E.P.I.L |
| Date | : 22-June-2021 |
| Test Expert | : Ms. Takzare |
| Normative Document | : IEC 60871-1:2014 |

2.4.2 Ambient conditions

| | |
|---------------------|---------|
| Ambient Temperature | : 25 °C |
| Relative Humidity | : 45 % |

2.4.3 Performance of test

Capacitor loss tangent ($\tan\delta$) is measured at the end of the thermal stability test in accordance with clause 14 of IEC 60871-1:2014.

2.4.4 Acceptance condition of test

The value of $\tan\delta$ measured in accordance with clause 14.1 shall not exceed the value declared by the manufacturer, or the value agreed upon between manufacturer and purchaser.

2.4.5 Result of Test

Table 5: Tangent of the loss angle measured at elevated temperature

| Applied Voltage (kV) | Measured $\tan\delta$ | Result |
|----------------------|-----------------------|------------|
| 23.0 | 1.06×10^{-4} | Performed* |

* The requirements regarding capacitor losses shall be agreed upon between manufacturer and purchaser. Since no value was notified to the laboratory, the result of the test is given as "Performed".

3. FIGURES



| PKC - CAPACITOR | |
|---------------------------------|---|
| Capacitor according to IEC60871 | |
| Type | PK 200/19.05 EDRI |
| Rated voltage at 50 Hz | 19.05 KV |
| Rated output at 50 Hz | 200 KVAR |
| Rated Capacitance | 1.76 μ F |
| Rated Current at 50 Hz | 10.5A |
| Rated Frequency | 50Hz |
| Insulation level | 50/145 Kv |
| Internal fuse | NO |
| Temperature category | -40/+55C |
| Discharge device |  |
| Impregation | |
| Connection symbol |  |
| Project NO: | T-T-19.05 |
| Made In Iran -Parto khazen | |
| NON-PCB | |

Figure 1: Nameplate of equipment under test

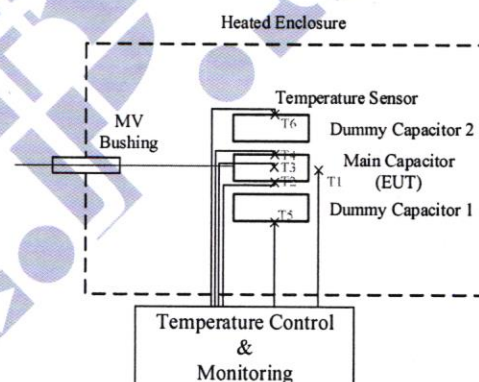


Figure 2: Sensors arrangement during the thermal stability test


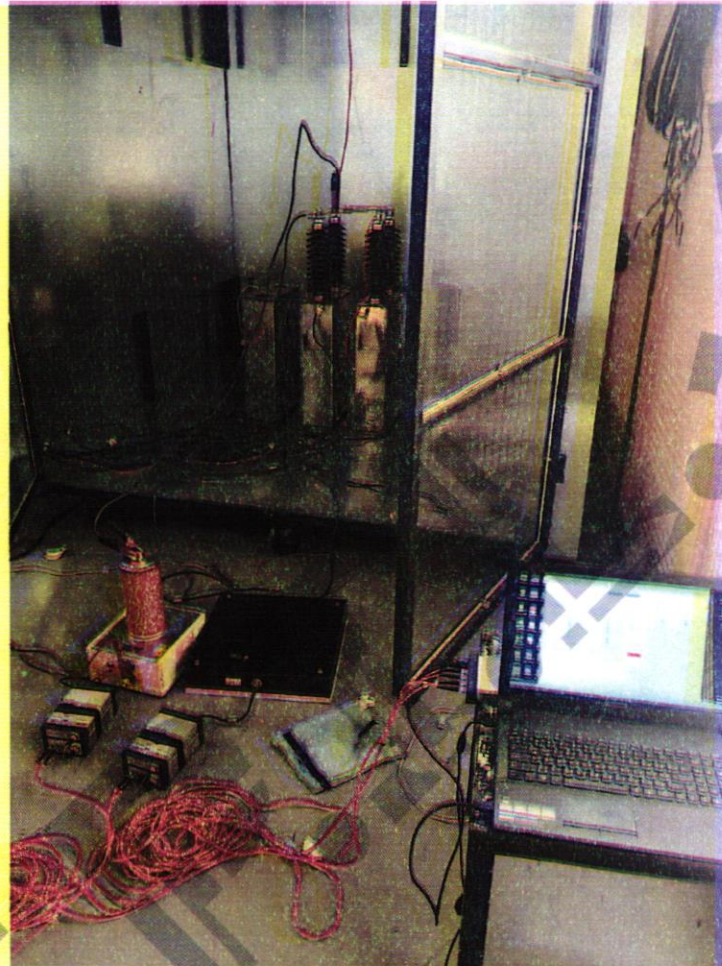


Figure 3: Equipment under tangent of the loss angle test at ambient temperature

ANNEX A: EUT ELEMENT CONFIGURATION

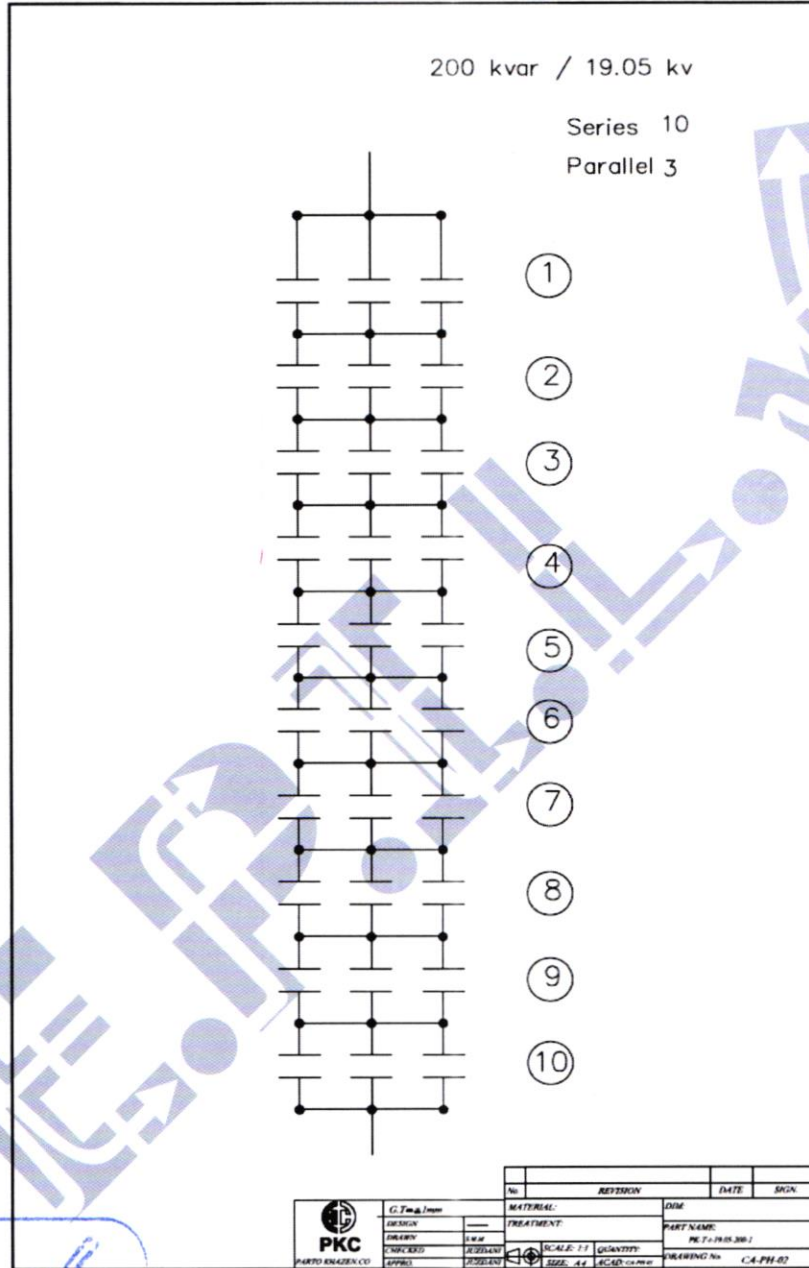

EPIL
Technical Department
ISO IEC 17025
Accredited Lab

*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*