

Test report: H13-70002

Page 1 of 10

LQF-708-02
Review No:06

EPIL/HV TEST REPORT

Project No.: H13-70002

Equipment under Test: MV Capacitor

Type	: PK 400/11.56 EDRI
Serial Number	: PK-T-t-11.56-1
Rated Voltage	: 11.56 kV
Rated Power	: 400 kVAR
Rated Capacitance	: 9.53 μ F
Rated Frequency	: 50 Hz
Rated Current	: 34.61 A
Insulation Level	: 28/95 kV
Temperature Category	: -40/55°C
Internal Fuse	: NO

Manufactured by: PARTO KHAZEN Co.

Applicant: PARTO KHAZEN Co.

Trade Mark: 

Applicant Contact Information: +98-21-88882956

Tested According to: IEC 60871-1:2014

Reception Date of Sample: 29-Mar-2021

Testing Date: 19-Jul-2021

Issue Date: 28-Jul-2021

Test Result: See pages 4 to 7

No. of Pages: 10

Prepared and Tested by: Test Engineer

Verified by: Technical Manager

A. Takzare

H. Jahangir


Chief Executive Officer

Engineering Deputy of
Test and Inspection

S. M. Mirsadri

Prof. B. Vahidi / Prof. S. H. Fathi

The statement of conformity decision is made based on EPIL Procedure No., CBP-708-01 and ISO/IEC Guide 98-4.



Technical Department
ISO IEC 17025
Accredited Lab

This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.

CONTENTS

	Page
1 GENERAL INFORMATION	3
1.1 Product Information.....	3
1.2 Client Information.....	3
1.3 Performed Tests.....	3
1.4 Test Results and Descriptions	3
2 PERFORMANCE and RESULTS of TESTS	4
2.1 Test of Internal Discharge Device (Routine Test).....	4
2.2 Lightning Impulse Voltage Test Between Terminals and Container (Type Test).....	5
2.3 Short Circuit Discharge Test (Type Test).....	7
3 FIGURES	8
ANNEX A: EUT ELEMENT CONFIGURATION	10



*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*

1. GENERAL INFORMATION

1.1. Product Information

Equipment under Test	: MV Capacitor
Manufacturer	: PARTO KHAZEN Co.
Type	: PK 400/11.56 EDRI
Serial Number	: PK-T-t-11.56-1
Rated Voltage	: 11.56 kV
Rated Power	: 400 kVAR
Rated Capacitance	: 9.53 μ F
Rated Frequency	: 50 Hz
Insulation Level	: 28/95 kV
Temperature Category	: -40/55°C
Internal Fuse	: NO
Normative Document	: IEC 60871-1:2014

1.2. Client Information


Applicant	: PARTO KHAZEN Co.
Telephone	: +98-21-88882956
Fax	: +98-21-88882959

1.3. Performed Tests

Test	Test According to	Result
Test of Internal Discharge Device (Routine Test)	IEC 60871-1:2014	Passed
Lightning Impulse Voltage Test between Terminals and Container (Type Test)	IEC 60871-1:2014	Passed
Short Circuit Discharge Test (Type Test)	IEC 60871-1:2014	Passed

1.4. Test Results and Descriptions:

See pages 4 to 7.


Technical Department
ISO IEC 17025
Accredited Lab

*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*

Test report: H13-70002

Page 4 of 10

2. PERFORMANCE and RESULTS of TESTS

2.1 Test of Internal Discharge Device (Routine Test)

2.1.1 Test data

Equipment Under Test (EUT)	: MV Capacitor
Manufacturer	: PARTO KHAZEN Co.
Location	: E.P.I.L
Date	: 19-Jul-2021
Test Expert	: Ms. Takzare
Normative Document	: IEC 60871-1:2014

2.1.2 Ambient conditions

Ambient Temperature	: 29 °C
Relative Humidity	: 50 %

2.1.3 Performance of test

The resistance of the internal discharge device, is checked by a resistance measurement.

2.1.4 Acceptance conditions of test

According to annex D of IEC 60871-1:2014, the discharge resistance in single phase unit is computed from the equation:

$$R \leq \frac{t}{C \ln\left(\frac{U_N \sqrt{2}}{U_R}\right)}$$

2.1.5 Result of test

Table 1. Test of internal discharge device

Measured Resistance	Acceptance Criteria	Result
6.07 MΩ	≤ 11.7 MΩ	Passed


Technical Department
ISO IEC 17025
Accredited Lab

This report should not be reproduced in extracts without written approval by EPIL.

Test results pertain to the tested sample only.

Not Valid Without Lab Stamp.

2.2 Lightning Impulse Voltage Test between Terminals and Container (Type Test)

2.2.1 Test data

Equipment Under Test (EUT)	: MV Capacitor
Manufacturer	: PARTO KHAZEN Co.
Location	: E.P.I.L
Date	: 11-Jul-2021
Test Expert	: Ms. Takzare
Normative Document	: IEC 60871-1:2014

2.2.2 Ambient conditions

Ambient Temperature	: 29.2 °C
Relative Humidity	: 50.1 %

2.2.3 Performance of test

The EUT is subjected to fifteen impulses of positive polarity followed by 15 impulses of negative polarity between the terminals (joined together) and the container. The lightning impulse test is done in accordance with IEC 60060-1 but with a wave of 1.2/50 μ s having a crest value corresponding to 18.1 of IEC 60871-1.

2.2.4 Acceptance condition of test

The capacitor is considered to have passed the test if:

- No puncture has occurred.
- Not more than two external flashovers occurred at each polarity.
- The waveshape has revealed no irregularities or significant deviation from recordings at reduced test voltage.

E.P.I.L.
Technical Department
ISO IEC 17025
Accredited Lab

This report should not be reproduced in extracts without written approval by EPIL.

Test results pertain to the tested sample only.

Not Valid Without Lab Stamp.

2.2.5 Result of Test

Table 2 shows the results of the test.

Table 2: Result of lightning impulse test between terminals and container

Rated Voltage (kV)	Applied Voltage (kV)	Number of Impulses	Result
11.56	95	15+/15-	Passed




Technical Department
ISO IEC 17025
Accredited Lab

*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*

Test report: H13-70002

Page 7 of 10

LQF-708-02
Review No:06

2.3 Short Circuit Discharge Test (Type Test)

2.3.1 Test data

Equipment under Test (EUT)	: MV Capacitor
Manufacturer	: PARTO KHAZEN Co.
Location	: E.P.I.L
Date	: 19-Jul-2021
Test Expert	: Ms. Takzare
Normative Document	: IEC 60871-1:2014

2.3.2 Ambient conditions

Ambient Temperature	: 29.8 °C
Relative Humidity	: 50.4 %

2.3.3 Performance of test

The EUT is charged by means of d.c. and then discharged through a gap situated as close as possible to the capacitor. The EUT is subjected to five such discharges within 10 min with test voltage of $2.5 U_N$.

2.3.4 Acceptance conditions of test

The capacitance shall be measured before and after the discharge tests. The differences between the two measurements shall be less than an amount corresponding to either breakdown of an element.

2.3.5 Result of Test

Table 3 shows the results of the test.

Table 3: Result of short circuit discharge test

Applied d.c. Voltage (kV)	Measured Capacitance before the Test (μ F)	Measured Capacitance after the Test (μ F)	Result
28.9	9.50	9.52	Passed

Technical Department
ISO IEC 17025
Accredited Lab

*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*

Test report: H13-70002

Page 8 of 10

LQF-708-02
Review No:06

3. FIGURES

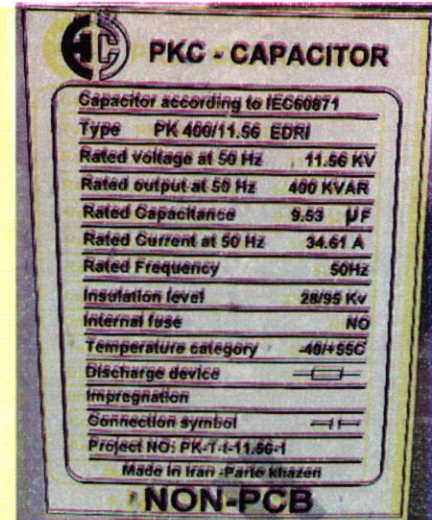


Figure 1: Nameplate of equipment under test



Figure 2: Equipment under lightning impulse voltage test between terminals and container



*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*

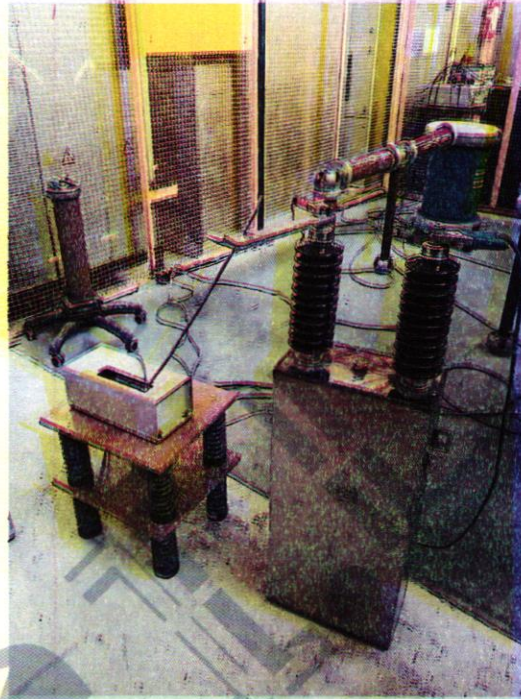



Figure 3: Equipment under short circuit discharge test


Technical Department
ISO IEC 17025
Accredited Lab

*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*

Test report: H13-70002 Page 10 of 10
ANNEX A: EUT ELEMENT CONFIGURATION

LQF-708-02
Review No:06

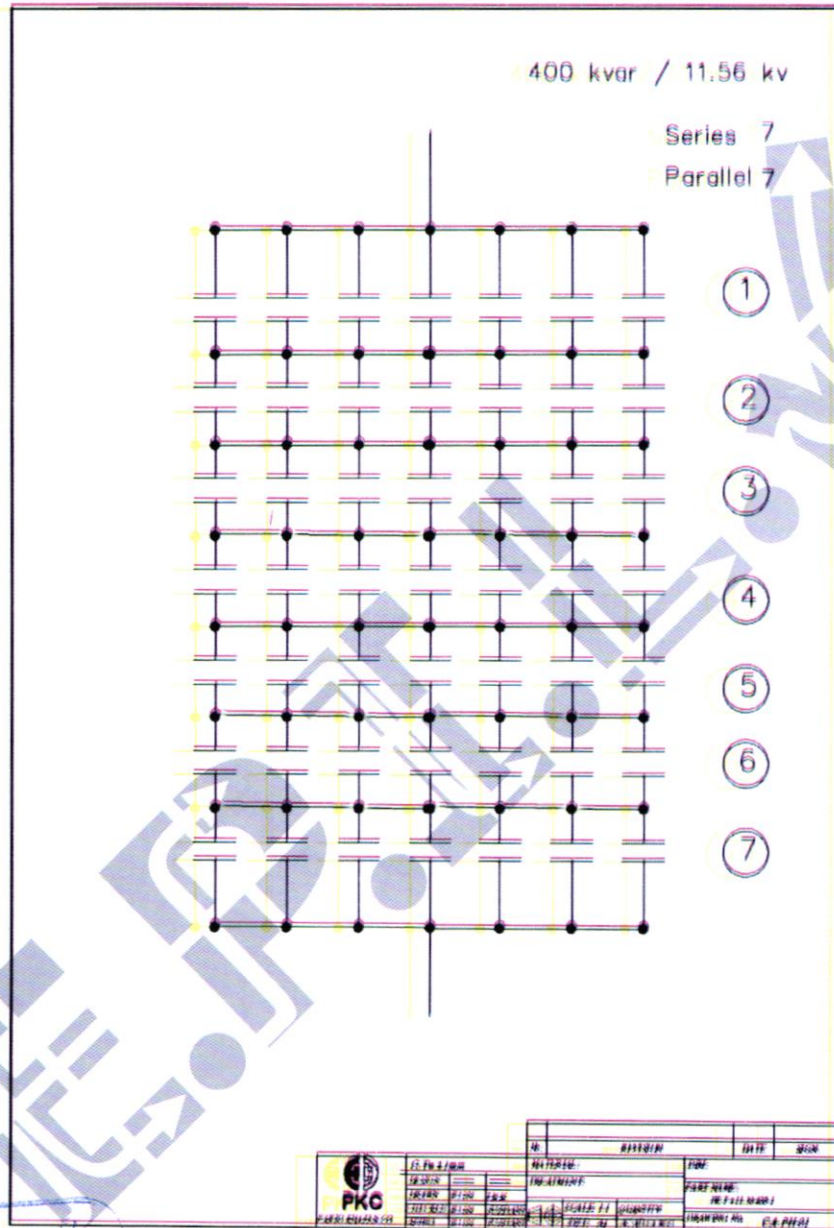

	ELEMENT NO: ELEMENT TYPE: ELEMENT VALUE: ELEMENT TOLERANCE: ELEMENT MANUFACTURER: ELEMENT DATE: ELEMENT LOCATION: ELEMENT STATUS: ELEMENT COMMENTS:	TEST NO: TEST DATE: TEST TIME: TEST LOCATION: TEST STATUS: TEST COMMENTS:	TESTER: CHECKER: APPROVER: DATE: TIME: LOCATION:
	TESTER: CHECKER: APPROVER: DATE: TIME: LOCATION:	TEST NO: TEST DATE: TEST TIME: TEST LOCATION: TEST STATUS: TEST COMMENTS:	TESTER: CHECKER: APPROVER: DATE: TIME: LOCATION:

E.P.I.L.
Technical Department
ISO IEC 17025
Accredited Lab

*This report should not be reproduced in extracts without written approval by EPIL.
Test results pertain to the tested sample only.
Not Valid Without Lab Stamp.*